
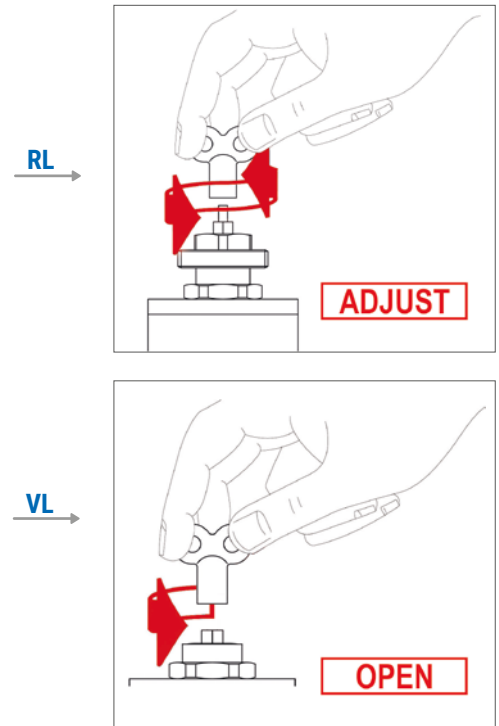


Druckstufe/System: PN 6 / nur für Heizungsanlagen mit Wasserqualität nach VDI 2035/SWKI BT102-01/ÖNORM H 5195-1, ohne Zusätze
 Pressure stage/system: PN 6 / only for heating systems with water quality according to VDI 2035/SWKI BT102-01/ÖNORM H 5195-1, without additives
 Stadio/sistema di pressione: PN 6 / solo per impianti di riscaldamento con qualità dell'acqua secondo VDI 2035/SWKI BT102-01/ÖNORM H 5195-1, senza additivi

Einregulierung / Balancing / Bilanciamento

- Integrierte Regulier- und Absperrverschraubung im VL öffnen**
 Open Built-in balancer lockshields
 Aprire detentori di bilanciamento
- Durchfluss herstellen**
 Generate and control flow
 Controllo di flusso
- RL-Ventil einregulieren**
 Balance return valve
 Bilanciamento valvola di ritorno

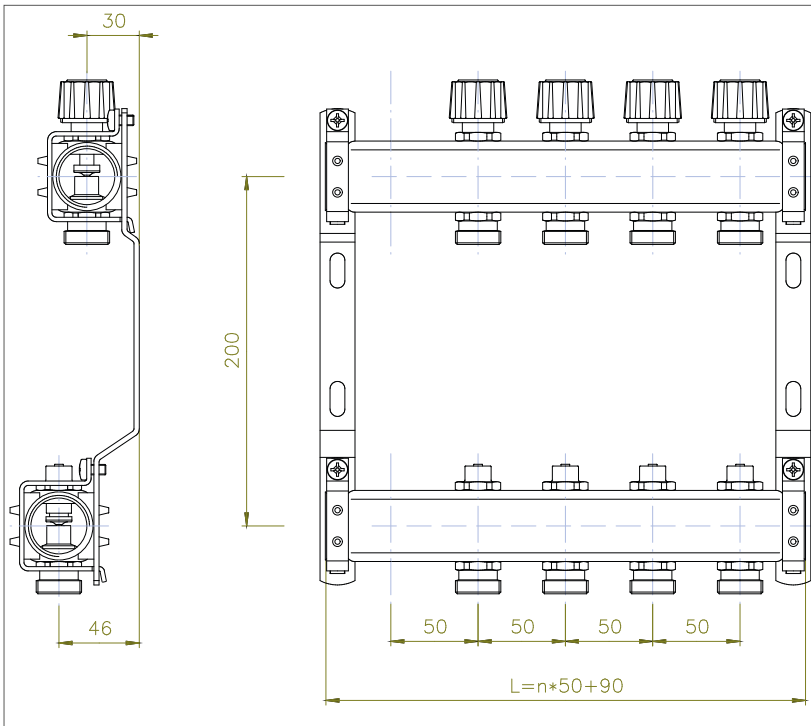

Druckverlustdiagramm / Pressure drop graph / Diagramma delle perdite di carico 3

