


- AGA/TP-koppel 1970-88
1-rörssystem, märkning röd tejp.
- AGA/TP manifold 1970-88
1-pipe system, red tape marking.
- AGA/TP Ventilgarnitur 1970-88
1-Rohrsystem, Markierung roter Klebestreifen.

AB Markaryds Metallarmatur 4 8237 01
Tel. +46 (0)433 737 00 120131 rev. 04





1



Demontera befintlig
Remove existing
Vorhandenes ausbauen

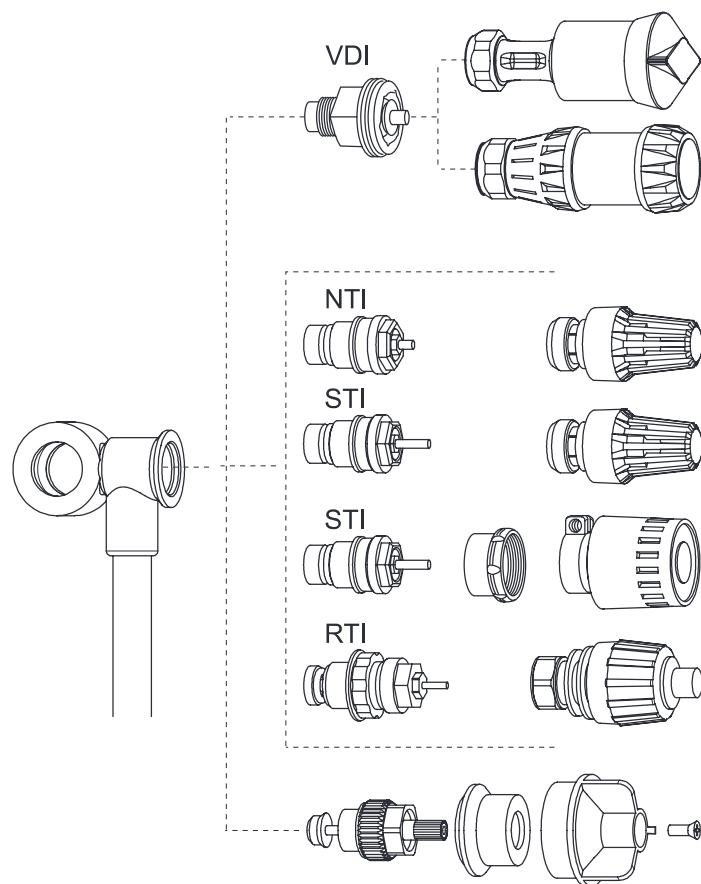

2

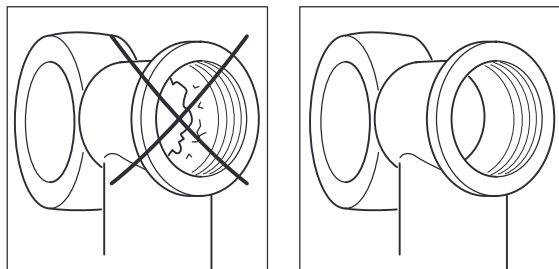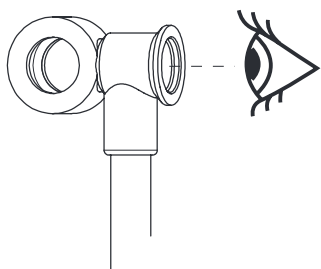

3

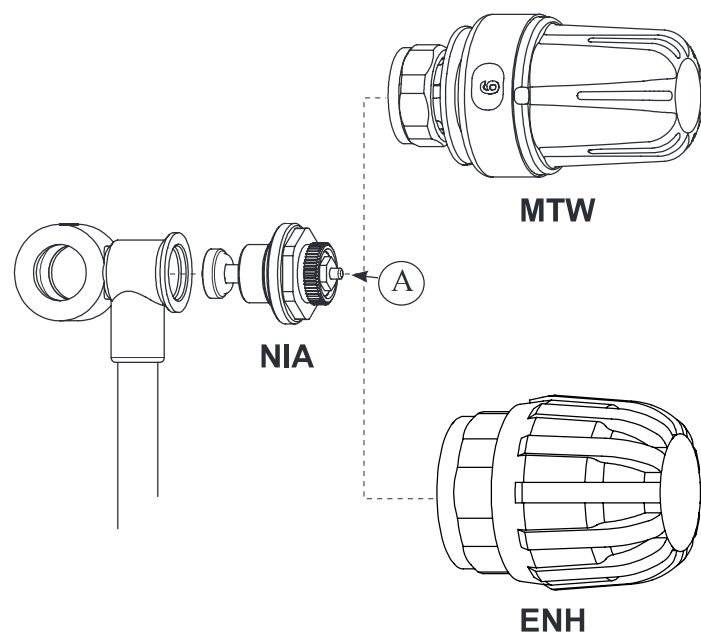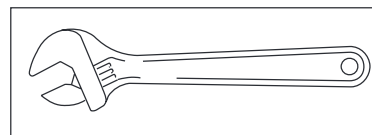

- A**
- Packboxens sexkant ska vara ca 1 mm ovanför insatsen.
 - The stuffingbox will be set about 1 mm above the insert.
 - Der Stopfbüchse muß 1 mm oben dem Einsatz werden.
-